





DATE: _____

PROJECT: _____

LOCATION: _____

Coated Steel Lab Exhauster Curb
QMXLE, QMXHPLE, QMXVP
QMXHPVP, QMXVPA, QMXHPVPA
Single (1x1) Configuration
18" High

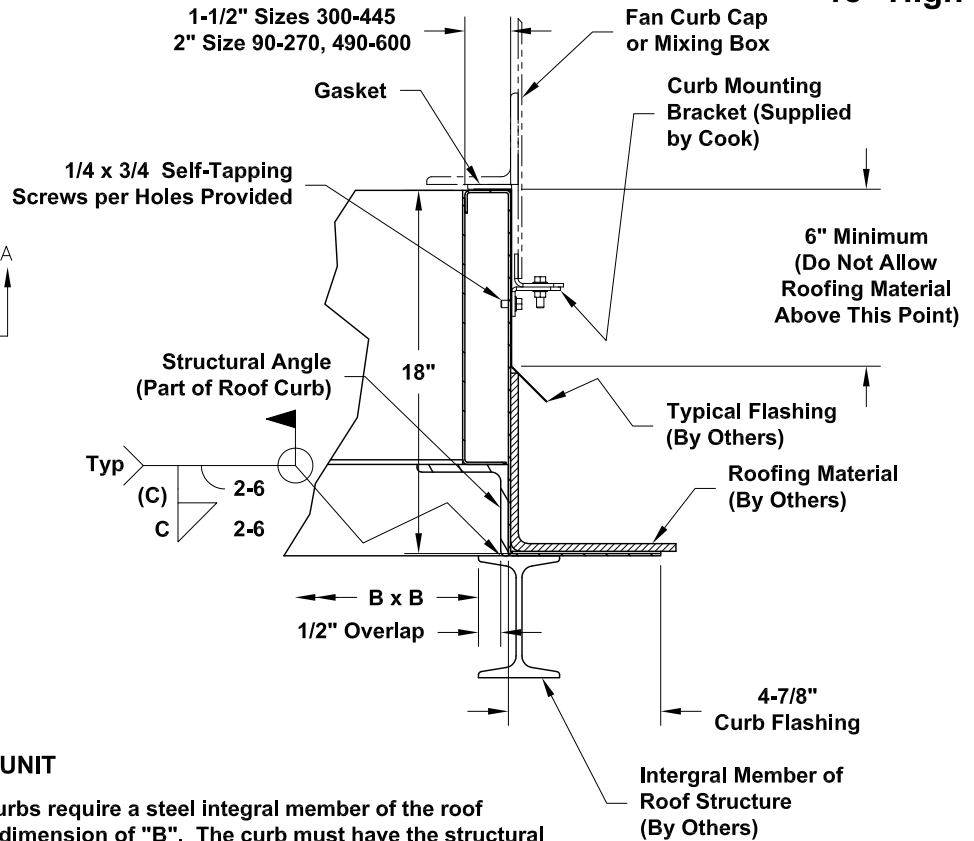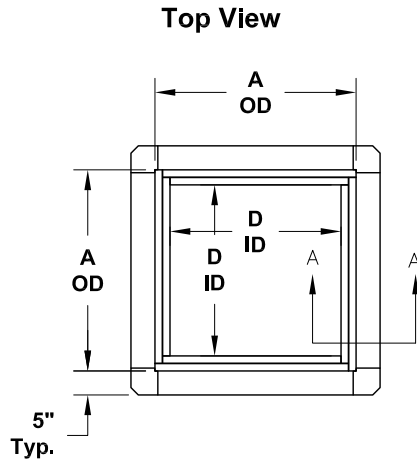


***CURB TO BE COATED SAME AS UNIT**

Note: All Lab Exhaust Curbs require a steel integral member of the roof structure with an inside dimension of "B". The curb must have the structural angle field welded to the steel roof structure. Steel roof structure to be determined by the engineer of record.


DIMENSION DATA

Size	A	B	C	D	Curb Gauge	Approx. Curb Wt.
90	27-3/16	25-5/16	1/4	20-13/16	7	279
120	27-3/16	25-5/16	1/4	20-13/16	7	279
135	27-1/8	25-1/4	1/4	20-3/4	7	278
150	29-1/8	27-1/4	1/4	22-3/4	7	300
165	31-1/8	29-1/4	1/4	24-3/4	7	321
180	33-1/8	31-1/4	1/4	26-3/4	7	343
202	36-15/16	35-1/16	1/4	30-9/16	7	384
225	40-15/16	39-1/16	1/4	34-9/16	7	427
245	42-15/16	41-1/16	1/4	36-9/16	7	449
270	46-15/16	45-1/16	1/4	40-9/16	7	492
300	50-15/16	48-15/16	3/8	44-11/16	10	458
330	54-13/16	52-13/16	3/8	48-9/16	10	494
365	60-3/4	58-3/4	3/8	54-1/2	10	549
402	65-5/8	63-5/8	3/8	59-3/8	10	594
445	72-5/8	70-5/8	3/8	66-3/8	10	658
490	78-1/2	76-3/8	3/8	72-1/8	7	893
540	85-3/8	83-1/4	3/8	79	7	973
600	94-3/8	92-1/4	3/8	88	7	1078

ALL DIMENSIONS IN INCHES. WEIGHTS IN LBS.,

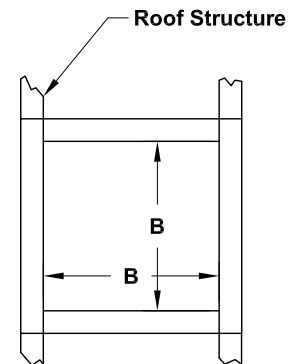

Roof Opening



Curb Corner