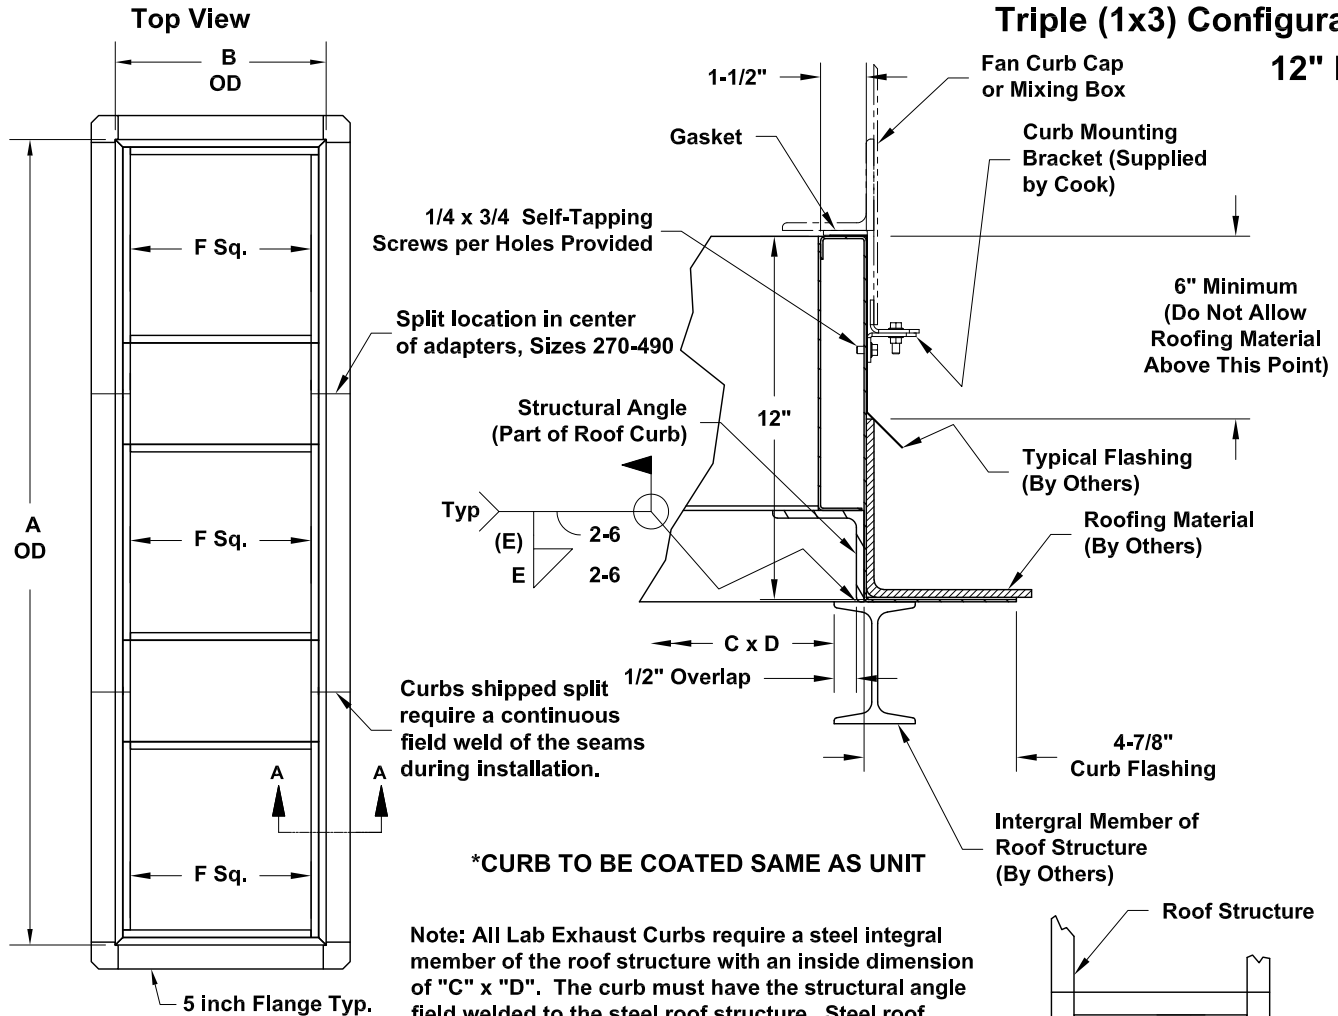


DATE: _____

PROJECT: _____

LOCATION: _____

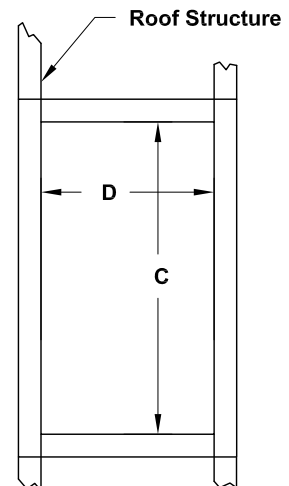

Accessory Data Sheet
Coated Steel Lab Exhaust Curb
TCNHBLE
Triple (1x3) Configuration
12" High


Note: All Lab Exhaust Curbs require a steel integral member of the roof structure with an inside dimension of "C" x "D". The curb must have the structural angle field welded to the steel roof structure. Steel roof structure to be determined by the engineer of record.

DIMENSION DATA

Size	A	B	C	D	E	F	Gauge Thickness	Approx. Curb Wt.
100	77-11/16	23-1/16	76	21-3/8	1/4	16-7/8	12	360
120	89-11/16	27-1/16	88	25-3/8	1/4	20-7/8	12	420
135	95-5/8	29	93-15/16	27-5/16	1/4	22-13/16	12	451
150	101-5/8	31	99-15/16	29-5/16	1/4	24-13/16	12	482
165	107-5/8	33	105-15/16	31-5/16	1/4	26-13/16	12	513
180	119-1/2	36-7/8	117-13/16	35-3/16	1/4	30-11/16	12	574
195	131-1/2	40-7/8	129-13/16	39-3/16	1/4	34-11/16	12	636
210	137-1/2	42-7/8	135-13/16	41-3/16	1/4	36-11/16	12	667
225	149-1/2	46-7/8	147-13/16	45-3/16	1/4	40-11/16	12	728
245	155-1/2	48-7/8	153-13/16	47-3/16	1/4	42-11/16	12	760
270	167-1/2	52-7/8	165-13/16	51-3/16	1/4	46-11/16	12	822
300	185-1/2	58-7/8	183-13/16	57-3/16	1/4	52-11/16	12	914
330	191-3/8	60-3/4	189-11/16	59-1/16	1/4	54-9/16	12	943
365	200-3/8	63-3/4	198-11/16	62-1/16	1/4	57-9/16	12	990
402	221-3/8	70-3/4	219-11/16	69-1/16	1/4	64-9/16	12	1098
445	236-3/8	75-3/4	234-11/16	74-1/16	1/4	69-9/16	12	1175
490	257-3/8	82-3/4	255-3/8	80-3/4	3/8	76-1/2	10	1720

ALL DIMENSIONS IN INCHES. WEIGHT IN LBS.


Roof Opening

Curb Corner

X0168R01