
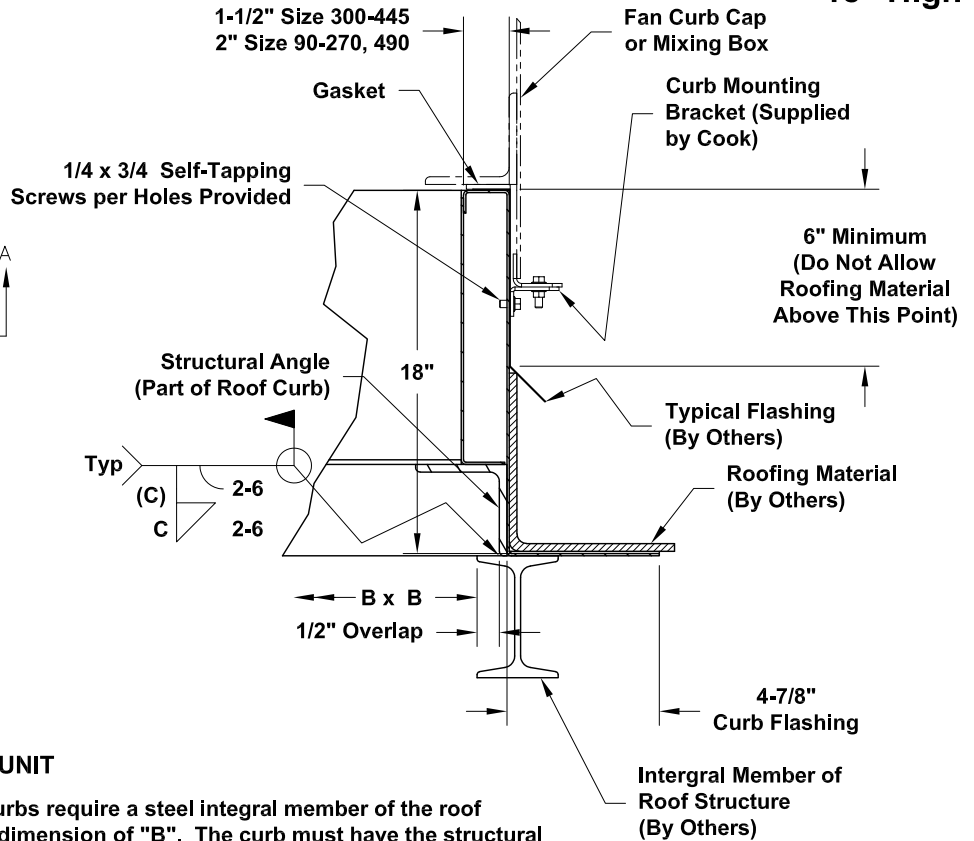


DATE: _____

PROJECT: _____

LOCATION: _____

Accessory Data Sheet
Coated Steel Lab Exhauster Curb
TCNHBLE
Single (1x1) Configuration
18" High

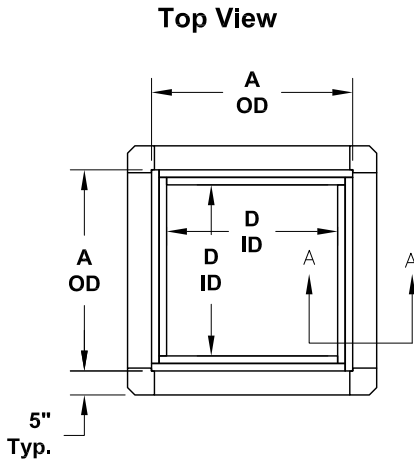


***CURB TO BE COATED SAME AS UNIT**

Note: All Lab Exhaust Curbs require a steel integral member of the roof structure with an inside dimension of "B". The curb must have the structural angle field welded to the steel roof structure. Steel roof structure to be determined by the engineer of record.


DIMENSION DATA

Size	A	B	C	D	Gauge Thickness	Approx. Curb Wt.
100	23-1/16	21-3/16	1/4	16-11/16	7	234
120	27-1/16	25-3/16	1/4	20-11/16	7	278
135	29	27-1/8	1/4	22-5/8	7	298
150	31	29-1/8	1/4	24-5/8	7	320
165	33	31-1/8	1/4	26-5/8	7	342
180	36-7/8	35	1/4	30-1/2	7	384
195	40-7/8	39	1/4	34-1/2	7	427
210	42-7/8	41	1/4	36-1/2	7	448
225	46-7/8	45	1/4	40-1/2	7	491
245	48-7/8	47	1/4	42-1/2	7	512
270	52-7/8	51	1/4	46-1/2	7	556
300	58-7/8	56-7/8	3/8	52-5/8	10	531
330	60-3/4	58-3/4	3/8	54-1/2	10	549
365	63-3/4	61-3/4	3/8	57-1/2	10	576
402	70-3/4	68-3/4	3/8	64-1/2	10	640
445	75-3/4	73-3/4	3/8	69-1/2	10	687
490	82-3/4	80-5/8	3/8	76-3/8	7	942

ALL DIMENSIONS IN INCHES. WEIGHT IN LBS.

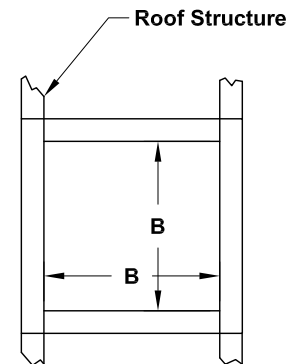

Roof Opening



Curb Corner