
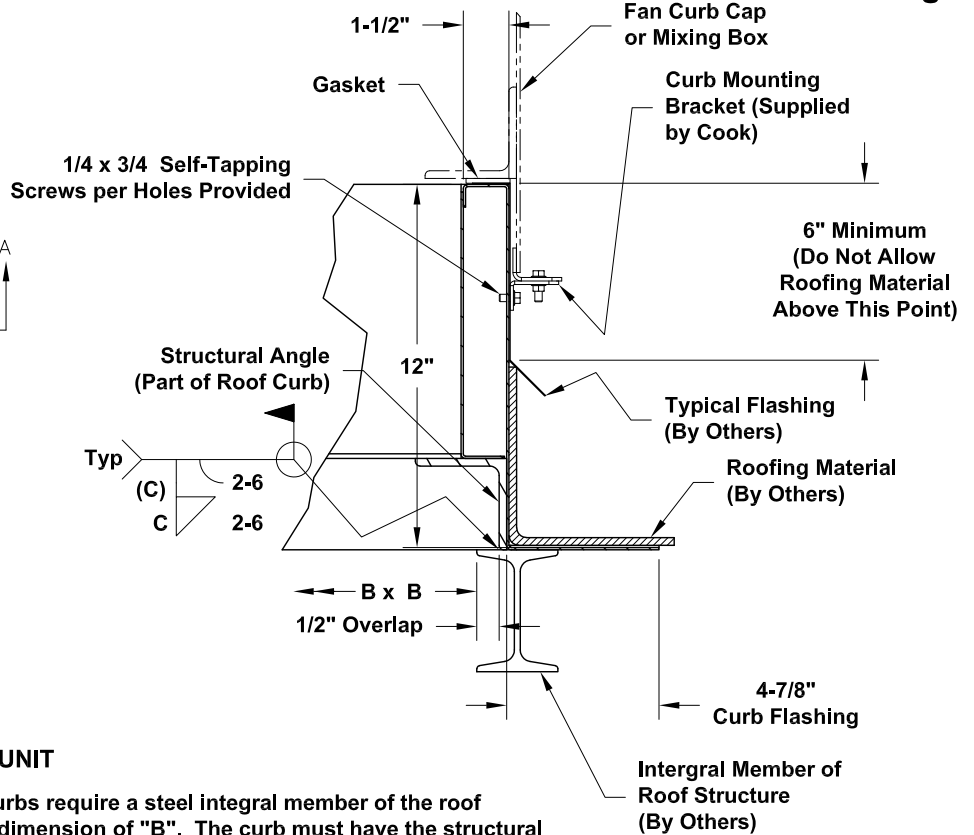


DATE: \_\_\_\_\_

PROJECT: \_\_\_\_\_

LOCATION: \_\_\_\_\_

**Accessory Data Sheet**  
**Coated Steel Lab Exhauster Curb**  
**TCNHBLE**  
**Single (1x1) Configuration**  
**12" High**

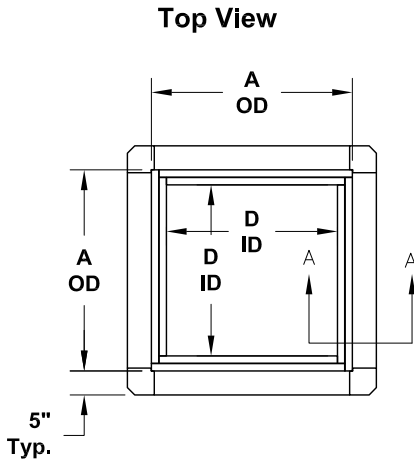


**\*CURB TO BE COATED SAME AS UNIT**

Note: All Lab Exhaust Curbs require a steel integral member of the roof structure with an inside dimension of "B". The curb must have the structural angle field welded to the steel roof structure. Steel roof structure to be determined by the engineer of record.


**DIMENSION DATA**

Size	A	B	C	D	Gauge Thickness	Approx. Curb Wt.
100	23-1/16	21-3/8	1/4	16-7/8	12	121
120	27-1/16	25-3/8	1/4	20-7/8	12	142
135	29	27-5/16	1/4	22-13/16	12	154
150	31	29-5/16	1/4	24-13/16	12	164
165	33	31-5/16	1/4	26-13/16	12	175
180	36-7/8	35-3/16	1/4	30-11/16	12	196
195	40-7/8	39-3/16	1/4	34-11/16	12	218
210	42-7/8	41-3/16	1/4	36-11/16	12	228
225	46-7/8	45-3/16	1/4	40-11/16	12	250
245	48-7/8	47-3/16	1/4	42-11/16	12	261
270	52-7/8	51-3/16	1/4	46-11/16	12	283
300	58-7/8	57-3/16	1/4	52-11/16	12	315
330	60-3/4	59-1/16	1/4	54-9/16	12	326
365	63-3/4	62-1/16	1/4	57-9/16	12	342
402	70-3/4	69-1/16	1/4	64-9/16	12	381
445	75-3/4	74-1/16	1/4	69-9/16	12	407
490	82-3/4	80-3/4	3/8	76-1/2	10	595

ALL DIMENSIONS IN INCHES. WEIGHT IN LBS.

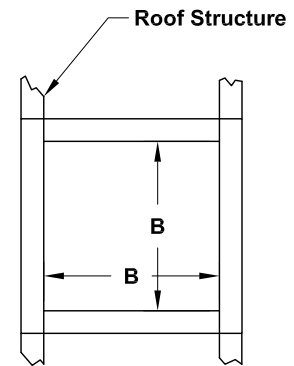

**Roof Opening**



**Curb Corner**